

## FIRE TEST CERTIFICATE

The element of construction described below was tested by EXOVA Warrington Fire on behalf of EzyStrut Cable & Pipe Supports, in accordance with the stated standard and achieved the test result stated below. Refer to the reference test for more information.

**Referenced reports**  
FAS210096, FRT200475 and FRT210003.

**Test Standard**  
AS/NZS3013:2005

**Description of Tested Product**  
EzyStrut N4 Cable Ladder

**Support Type**  
Cantilever Bracket

### Results Table

Product	Load (kg/m)	Support Span (m)	Width	Classification
N4	5	3	150mm 300mm 450mm 600mm	WS5X
	10	2.5		
	25	2		
	80	1.5		
	100	1		
	75	1	900mm	
	100	0.19		

For full description of test specimens refer referenced test reports.

**Testing Authority** Exova Warringtonfire Aus Pty Ltd

**Address** Unit 2, 409-411 Hammond Road, Dandenong VIC 3175

**ABN** 81 050 24 524

**Supplier** EzyStrut Cable & Pipe Supports (A Division of Korvest Ltd)

**ABN** 20 007 698 106

**Head Office** 580 Prospect Road, Kilburn SA 5084

**Phone** +61 8 8360 4550

**Website** www.ezystrut.com.au

**Authorisation**



Stephen Taubitz  
General Manager  
EzyStrut Cable & Pipe Supports




Brenton Davey  
Engineering Manager  
Korvest Ltd

**LOOK FOR THE EZYSTRUT FIRE RATED TO AS/NZS3013:2005 LOGO.**

It's a sure sign your cable management solution is designed in Australia, independently tested to meet Australian and New Zealand fire safety standards, and has been selected from Australia's widest range of fire rated products.

**AS/NZS3013:2005**  
**FIRE RATED**  
CABLE SUPPORT SYSTEMS

# FRN4CB FIRE RATED NEMA 4 CABLE LADDER ON CANTILEVER

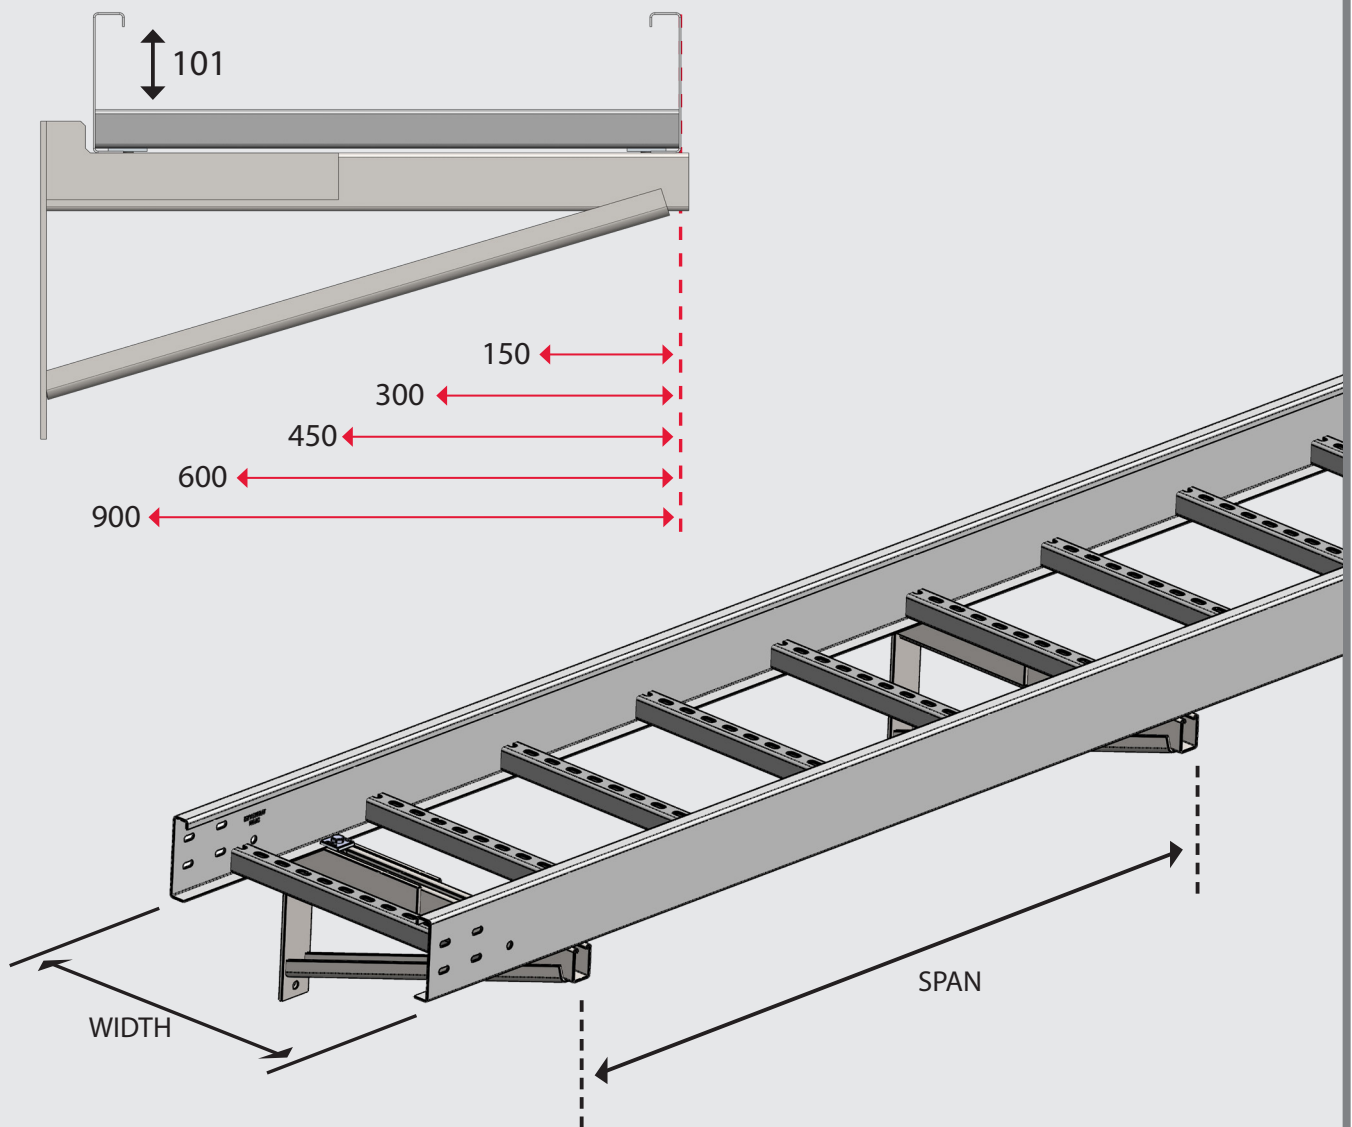


Load (kg/m)	Support Span (m)	Width Options	Length Options	Notes
5	3	150mm 300mm 450mm 600mm	3m 6m	All cantilever brackets are suitable for a 100kg centred point load
10	2.5			
25	2			
80	1.5			
100	1			
75	1	900mm	3m	
100	0.9	900mm		

EzyStrut will supply a tailored kit solution based on your selection from the load, width, length and tier options listed in the table above, as well as the overall length required.

**To ensure AS/NZS3013:2005 compliance, all ladder must be installed with the included splice plates, hold downs, cantilever brackets and fasteners, according to the recommended support span.**

# INSTALL GUIDE: FRN4 LADDER ON CANTILEVER

(this configuration is installed **twice** per cantilever bracket)

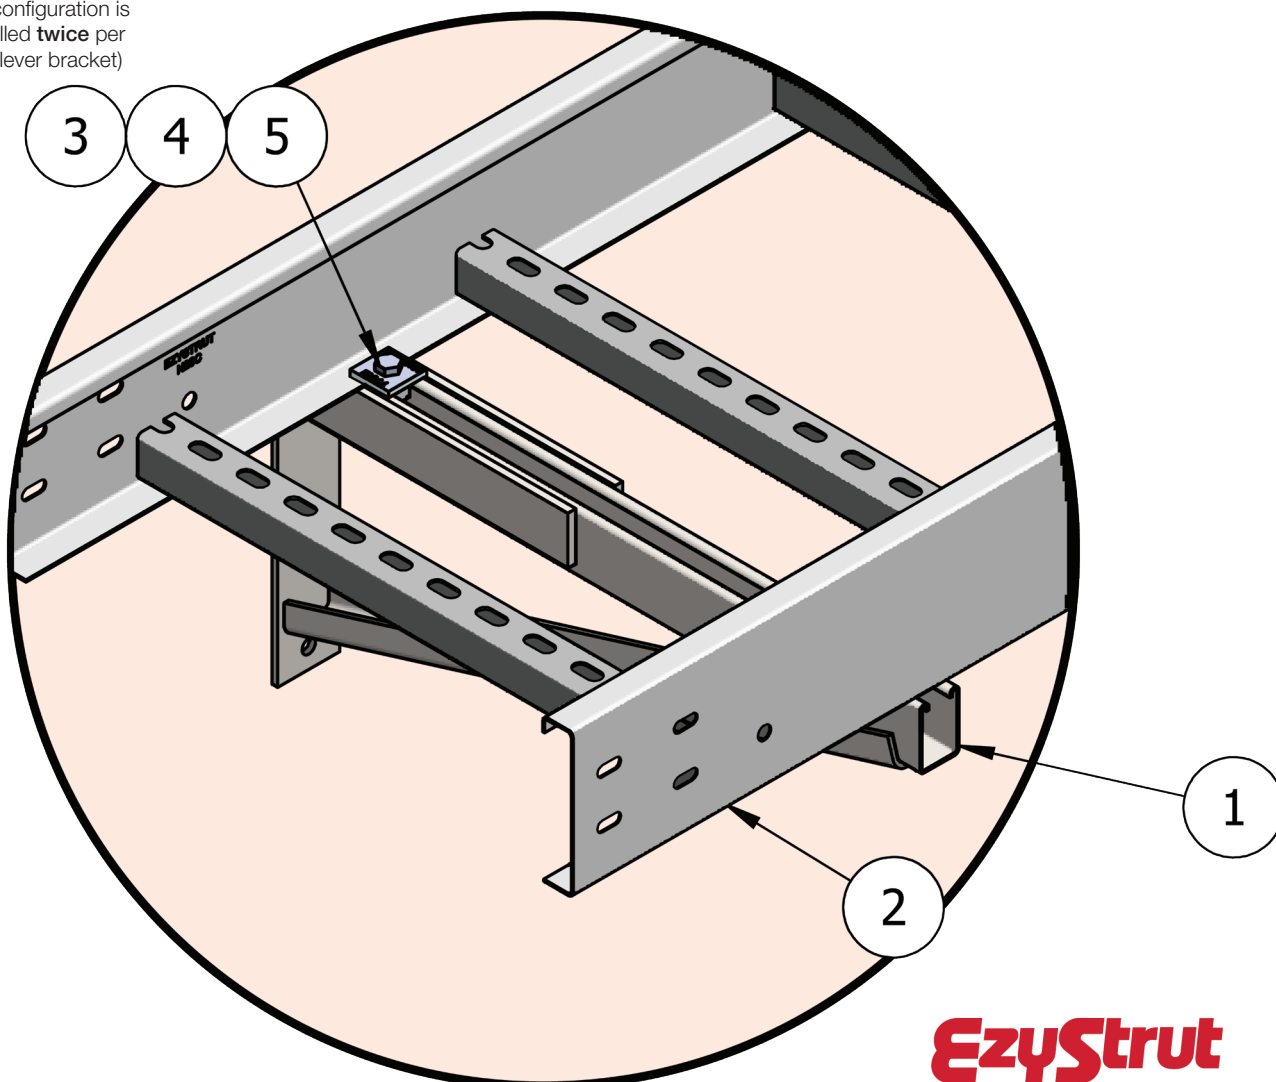

## KEY:

1	FRCB Cantilever Bracket	4	HS1235 Hex Screw
2	FRN4 Ladder	5	E1010 Channel Nut
3	E1064 Flat Plate Fitting		

**EzyStrut**  
Cable & Pipe Supports

AS/NZS3013:2005  
**FIRE RATED**  
CABLE SUPPORT SYSTEMS

This document is for installation guidance only, it should not be used as proof of conformance. All fire rated systems should be installed according to the originally quoted load ratings and support spans. Please contact EzyStrut for further information regarding compliance to the AS/NZS3013:2005 standards.