



## **FIRE TEST CERTIFICATE**

The element of construction described below was tested by EXOVA Warrington Fire on behalf of EzyStrut Cable & Pipe Supports, in accordance with the stated standard and achieved the test result stated below. Refer to the reference test for more information.

Referenced reports

FAS210096 and FRT200476.

Test Standard AS/NZS3013:2005

**Description of Tested Product** 

EzyStrut N4 Cable Ladder

**Support Type** 

H-Frame (up to three tiers)

## **Results Table**

Product	Load (kg/m)	Support Span (m)	Width	Classification
N4	5	3	150mm 300mm 450mm 600mm	WS5X
	10	2.5		
	25	2		
	80	1.5		
	100	1		

For full description of test specimens refer referenced test reports.


Testing Authority	Exova Warringtonfire Aus Pty Ltd		
Address	Unit 2, 409-411 Hammond Road, Dandenong VIC 3175		
ABN	81 050 24 524		
Supplier	EzyStrut Cable & Pipe Supports (A Division of Korvest Ltd)		
ABN	ABN 20 007 698 106		
Head Office	580 Prospect Road, Kilburn SA 5084		
Phone	+61 8 8360 4550		
Website	www.ezystrut.com.au		
Authorisation	Cf Jan B. Davey		

Stephen Taubitz General Manager EzyStrut Cable & Pipe Supports Brenton Davey Engineering Manager Korvest Ltd





## FRN4 FIRE RATED NEMA 4 CABLE LADDER ON H-FRAME

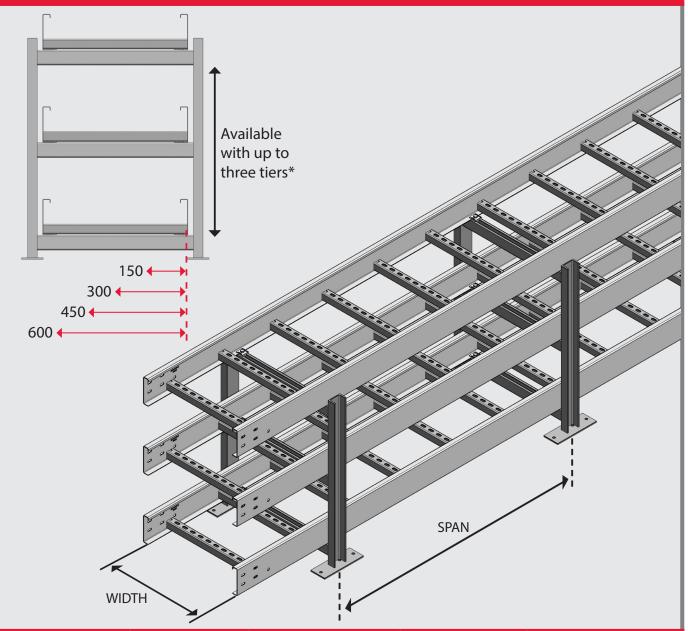

Load (kg/m)	Support Span (m)	Width Options	Length Options	Multi-Tier Options
5	3	150mm 300mm 450mm 600mm	3m 6m	Available for up to three tier installation*  * for standard H-Frames. Please contact EzyStrut for increased tier options.
10	2.5			
25	2			
80	1.5			
100	1			

EzyStrut will supply a tailored kit solution based on your selection from the load, width, length and tier options listed in the table above, as well as the overall length required.

To ensure AS/NZS3013:2005 compliance, all ladder must be installed with the included splice plates, hold downs, H-Frames and fasteners, according to the recommended support span.