



### **FIRE TEST CERTIFICATE**

The element of construction described below was tested by EXOVA Warrington Fire on behalf of EzyStrut Cable & Pipe Supports, in accordance with the stated standard and achieved the test result stated below. Refer to the reference test for more information.

Referenced reports FRT210367 R2.1 **Test Standard** AS/NZS3013:2005

**Description of Tested Product** EzyStrut N4 Cable Ladder **Support Type**Vertical, direct mounting method

#### **Results Table**


Product	Load (kg/m)	Support Span (m)	Width	Classification
N4	70	1.3	150mm 300mm 450mm 600mm	WS5X

For full description of test specimens refer referenced test reports.

Testing Authority	Exova Warringtonfire Aus Pty Ltd		
Address	Unit 2, 409-411 Hammond Road, Dandenong VIC 3175		
ABN	81 050 24 524		
Supplier	EzyStrut Cable & Pipe Supports (A Division of Korvest Ltd)		
ABN	20 007 698 106		
Head Office	580 Prospect Road, Kilburn SA 5084		
Phone	+61 8 8360 4550		
Website	www.ezystrut.com.au		
Authorisation	General Manager E	renton Davey ngineering Manager orvest Ltd	



# FRN4-OEH FIRE RATED NEMA 4 (ON EDGE, HORIZONTAL)

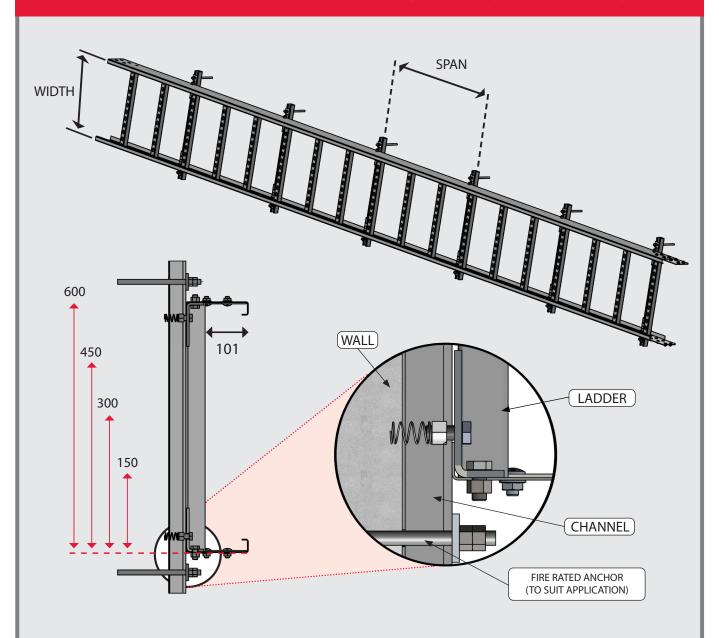


Load	Support	Width	Length
(kg/m)	Span (m)	Options	Options
70	1.3	150mm 300mm 450mm 600mm	6m

EzyStrut will supply a tailored kit solution based on your selection from the load, width, length and tier options listed in the table above, as well as the overall length required.

To ensure AS/NZS3013:2005 compliance, all ladder must be installed with the included splice plates, hold downs, channel, and fasteners, according to the recommended support span.

## **INSTALL GUIDE:** FRN4 LADDER (ON EDGE, HORIZONTAL)

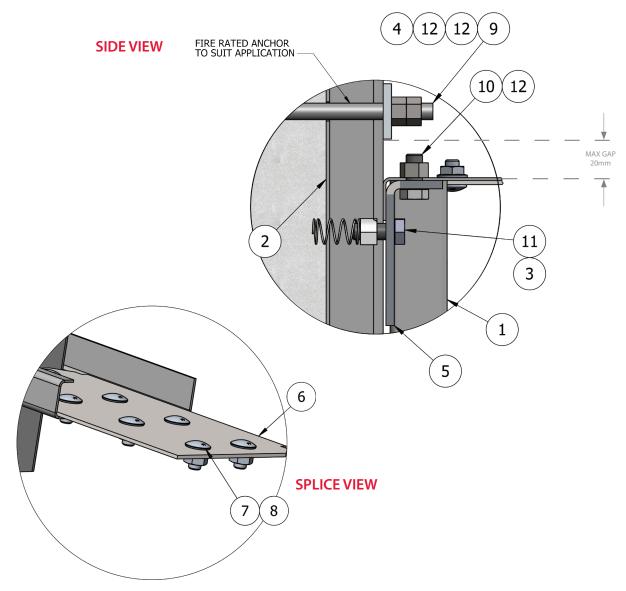

## KEY:





1	FRN4 Ladder	7	SB Splice Bolt
2	E1000S Channel (cut to length)	8	CN Splice Nut
3	E1010 Channel Nut	9	Fire Rated Anchor (to suit application)
4	E1064 Flat Fitting	10	HN1225 Hex Screw
5	E1326 Angle Fitting	11	HN1230 Hex Screw
6	N4S Splice Plate	12	HN12 Hex Nut

This document is for installation guidance only, it should not be used as proof of conformance. All fire rated systems should be installed according to the originally quoted load ratings and support spans. Please contact EzyStrut for further information regarding compliance to the AS/NZS3013:2005 standards.