

FIRE TEST CERTIFICATE

The element of construction described below was tested by EXOVA Warrington Fire on behalf of EzyStrut Cable & Pipe Supports, in accordance with the stated standard and achieved the test result stated below. Refer to the reference test for more information.

Referenced reports
20230927-FRT220362 R1.0

Test Standard
AS/NZS3013:2005

Description of Tested Product
EzyStrut N4 Cable Ladder

Support Type
Vertical, channel and sleeve mounted

Results Table

Product	Load (kg/m)	Support Span (m)	Width	Classification
N4	70	1.5	150mm 300mm 450mm 600mm	WS5X

For full description of test specimens refer referenced test reports.

Testing Authority Exova Warringtonfire Aus Pty Ltd

Address Unit 2, 409-411 Hammond Road, Dandenong VIC 3175

ABN 81 050 24 524

Supplier EzyStrut Cable & Pipe Supports (A Division of Korvest Ltd)

ABN 20 007 698 106

Head Office 580 Prospect Road, Kilburn SA 5084

Phone +61 8 8360 4550

Website www.ezystrut.com.au

Authorisation



Stephen Taubitz
General Manager
EzyStrut Cable & Pipe Supports




Brenton Davey
Engineering Manager
Korvest Ltd

LOOK FOR THE EZYSTRUT FIRE RATED TO AS/NZS3013:2005 LOGO.

It's a sure sign your cable management solution is designed in Australia, independently tested to meet Australian and New Zealand fire safety standards, and has been selected from Australia's widest range of fire rated products.

AS/NZS3013:2005
FIRE RATED
CABLE SUPPORT SYSTEMS

FRN4V FIRE RATED NEMA 4 VERTICAL (CHANNEL & SLEEVE MOUNT)

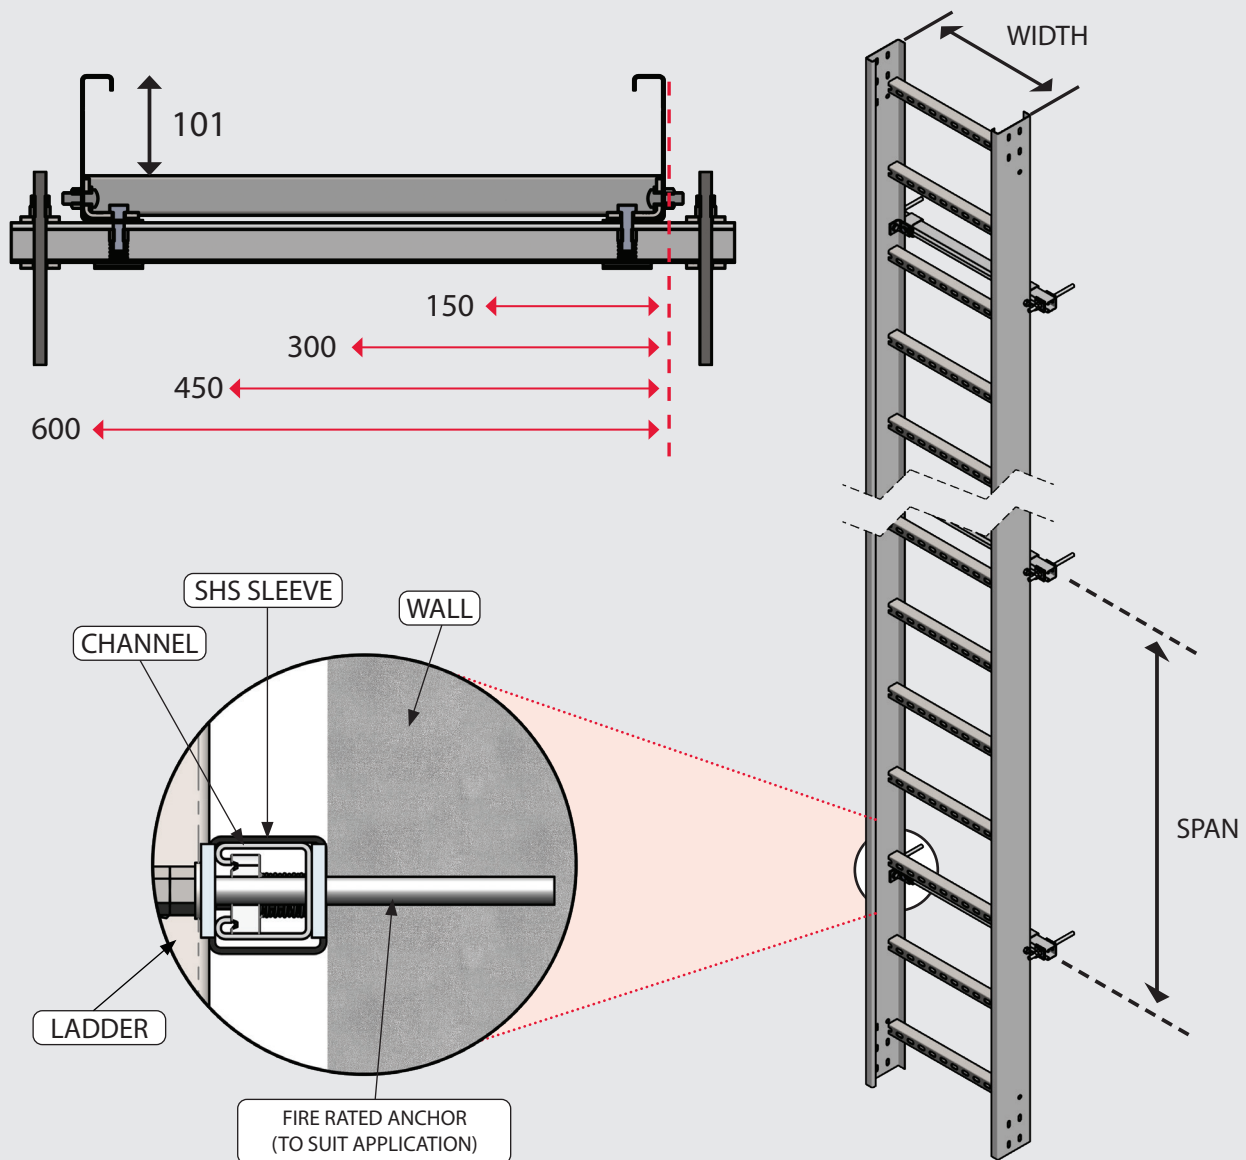


Load (kg/m)	Support Span (m)	Width Options	Length Options
70	1.5	150mm 300mm 450mm 600mm	6m

EzyStrut will supply a tailored kit solution based on your selection from the load, width, length and tier options listed in the table above, as well as the overall length required.


To ensure AS/NZS3013:2005 compliance, all ladder must be installed with the included splice plates, hold downs, channel, sleeve mounts and fasteners, according to the recommended support span.

INSTALL GUIDE: FRN4 LADDER (VERTICAL - CHANNEL & SLEEVE MOUNT)

TOP VIEW

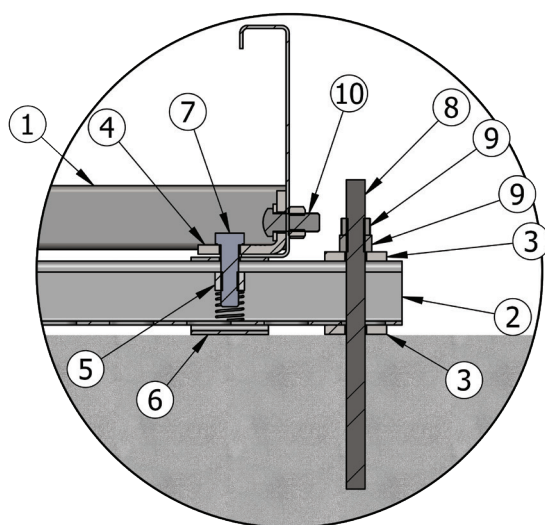

SIDE VIEW

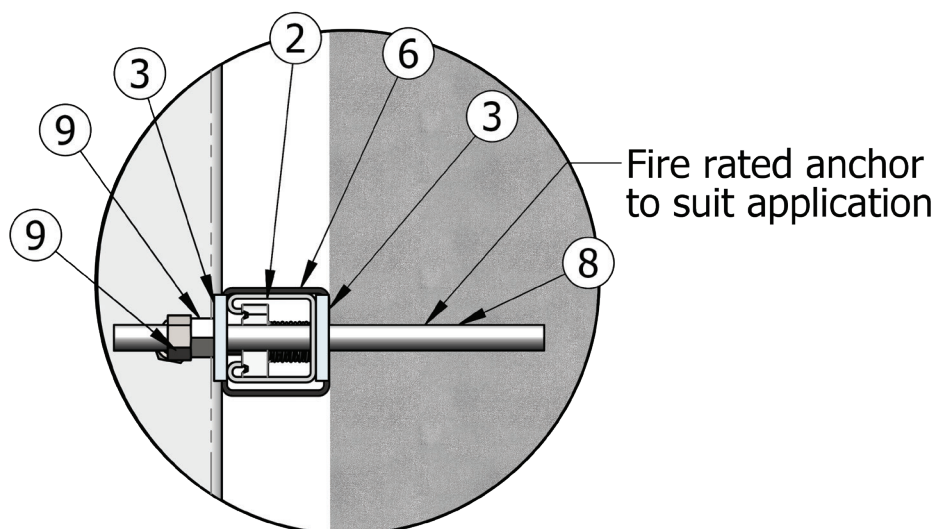

KEY:

EzyStrut AS/NZS3013:2005
Cable & Pipe Supports **FIRE RATED**
CABLE SUPPORT SYSTEMS

1	FRN4 Ladder	6	LV109SHS50 Strut Sleeve
2	E1000S Channel (cut to length)	7	HS1240 Hex Screw
3	E1064 Flat Fitting	8	Fire Rated Anchor (to suit application)
4	E1068 Angle Fitting	9	HN12 Hex Nut
5	E1010 Channel Nut	10	FK1230 Fascia Kit

This document is for installation guidance only, it should not be used as proof of conformance. All fire rated systems should be installed according to the originally quoted load ratings and support spans. Please contact EzyStrut for further information regarding compliance to the AS/NZS3013:2005 standards.